



# MONTHLY OPERATIONS REPORT

## June 2019

Town of Discovery Bay, CA

**3595** Days of Safe Operations

**176,629** worked hours since last recordable incident

# TRAINING: Safety, Operations, & Equipment

## \* TRAINING:

- • Safety
  - Take 5 Safety Topics
  - Confine Space Training
  - Hearing Conservation
  
- Operation
  - None this Month

# **REPORTS SUBMITTED TO REGULATORY AGENCIES**

- \* Monthly Discharge Monitoring Report (DMR)**
- \* Monthly electronic State Monitoring Report (eSMR)**
- \* Monthly Coliform Report, State Water Board (WD)**

# WATER SERVICES

## Groundwater Well:

- 1B - Active
- 2 – Active
- 4 – Active
- 5B - Active (Standby only)
- 6 – Active
- 7 - Active

## 2019 Water Production Table (MG) by Month


January	February	March	April	May	June
37	37	40	63	92	111
July	August	September	October	November	December

## Bacteriological Test Results

Routine Bacteria Samples Collected	No. Total Coliform Positives	No. Fecal/E. coli Positives	Brown Water Calls	Fire Hydrant Flushing
• 16	• 0	• 0	• 0	• 10

# WATER USAGE

## Water Production

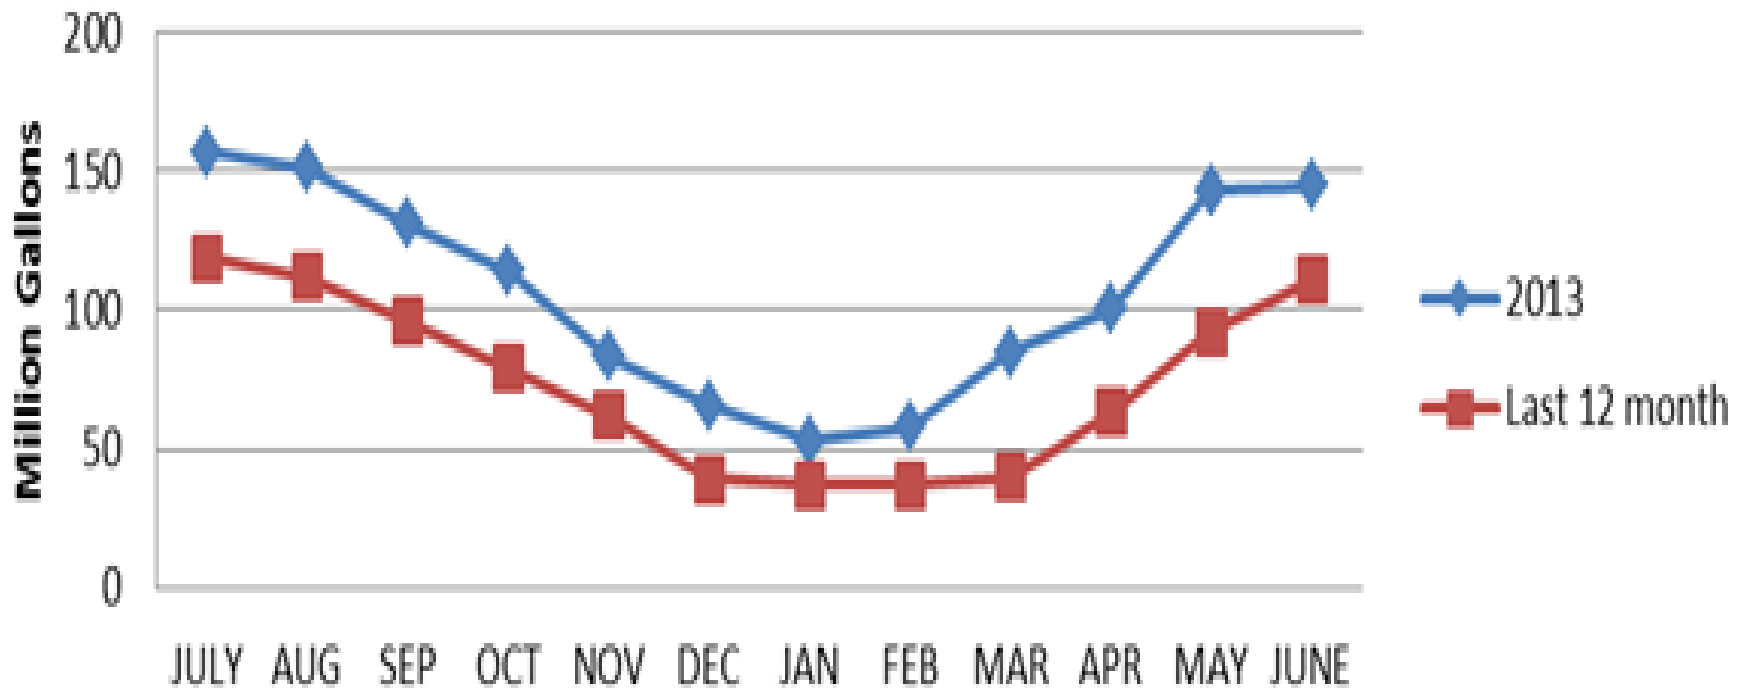

# Water Saved

## Reduction Compared to 2013



# WASTEWATER SERVICE

## Wastewater Laboratory Analysis

<i>WW Effluent Parameter</i>	<i>Permit Limits</i>	<i>May Lab Data</i>	<i>June Lab Data</i>
Flow, MG Effluent, <b>monthly total</b>	██████████	37	30
Flow, MG Daily Influent Flow, <b>avg.</b>	N/A	1.2	1.2
Flow, MG Daily Discharge Flow, <b>avg.</b>	2.1	1.0	1.0
Effluent BOD <sub>5</sub> , lbs/d, <b>monthly avg.</b>	390	10	16
Effluent TSS, lbs/d, <b>monthly avg.</b>	200*	5	6
Effluent BOD <sub>5</sub> , mg/L, <b>monthly avg.</b>	20	1	2
Effluent TSS, mg/L, <b>monthly avg.</b>	10*	1	1
Total Coli form 7 day Median Max	23	ND	ND
Total Coli form Daily Maximum	240	ND	2
% Removal BOD <sub>5</sub> , monthly avg.	85% min.	99%	99%
% Removal, TSS, monthly avg.	85% min.	99%	99%
Electrical Conductivity, umhos/cm <b>annual avg.</b>	2100	2280	2248

\* New Limit

# WASTEWATER SERVICE

## \* National Pollution Discharge Elimination System (NPDES)

NPDES Related Excursions	Permit Parameter	NPDES Parameter Limit	Actual Parameter Result
• 1	SSO	• N/A	• N/A

## COLLECTION:

# of Active Lift Stations	# of Inactive Lift Stations	SSO	Wastewater Received (MG)
15	0	1	3




# WASTEWATER SERVICE


- \* Continue sanitary sewer line assessment (63,000ft)
- \* Flushed/CCTV will be performed after assessment
- \* Manhole & covers inspection during assessment (254).

# Maintenance

## Preventive and Corrective

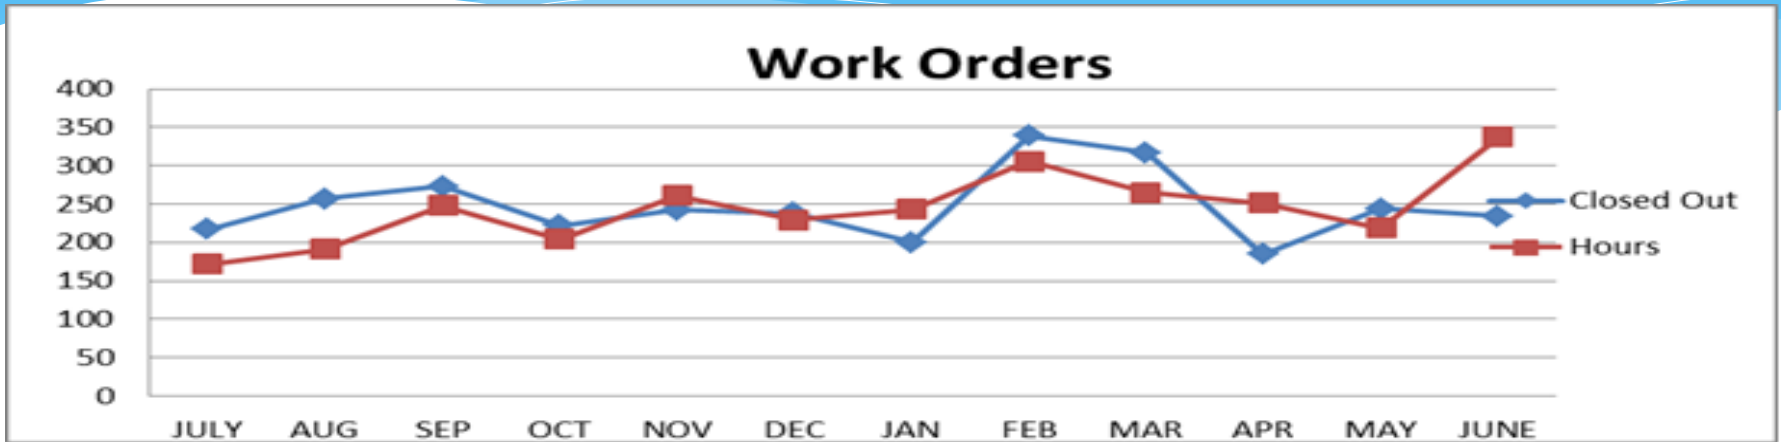

## Work Order Back-Log

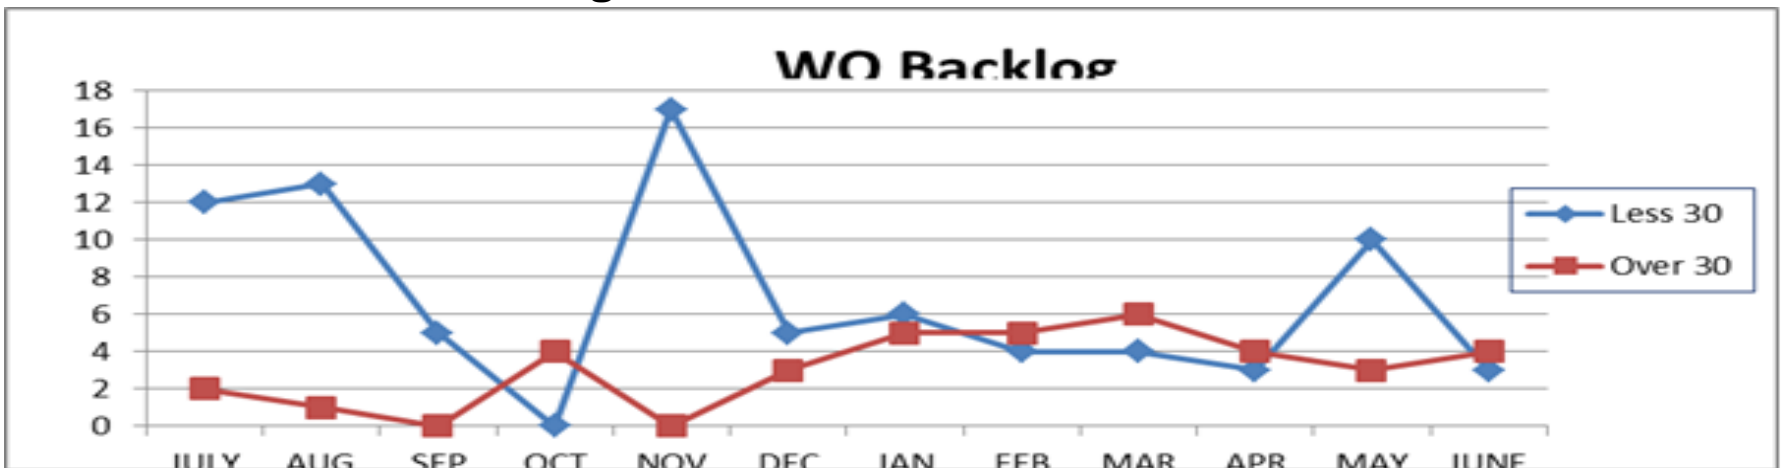

# General Info

## Call & Emergency Responses

Call Outs

8

Emergencies

0

## Personnel Hours & Overtime:

Regular Hours

1280

Overtime

39

# TERMS

WWTP	WASTEWATER TREATMENT PLANT
WTP	WATER TREATMENT PLANT
WL	WILLOW LAKE
NP	NEWPORT
VFD	VARIABLE FREQUENCY DRIVE
WO	WORK ORDER
PLC	PROGRAMMABLE LOGIC CONTROLLER
L/S	LIFT STATION
SSO	SANITARY SEWER OVERFLOW
BOD	BIOLOGICAL OXYGEN DEMAND
TSS	TOTAL SUSPENDED SOLIDS
MGD	MILLION GALLONS PER DAY
mg/l	MILLIGRAMS PER LITRE
CCTV	CLOSED CIRCUIT TELEVISION
PPM	PARTS PER MILLION
RAS	RETURN ACTIVATED SLUDGE
WAS	WATSE ACTIVATED SLUDGE
UV	ULTRAVIOLET LIGHT

# Lift Station R

Old Control Panel



New Control Panel

